




MBH	SUPPLY & RETURN	
	UP - FEED	DOWN - FEED
	PIPE SIZE	
0 - 15	1/2"	3/4"
16 - 40	3/4"	1"
41 - 65	1"	1 1/4"

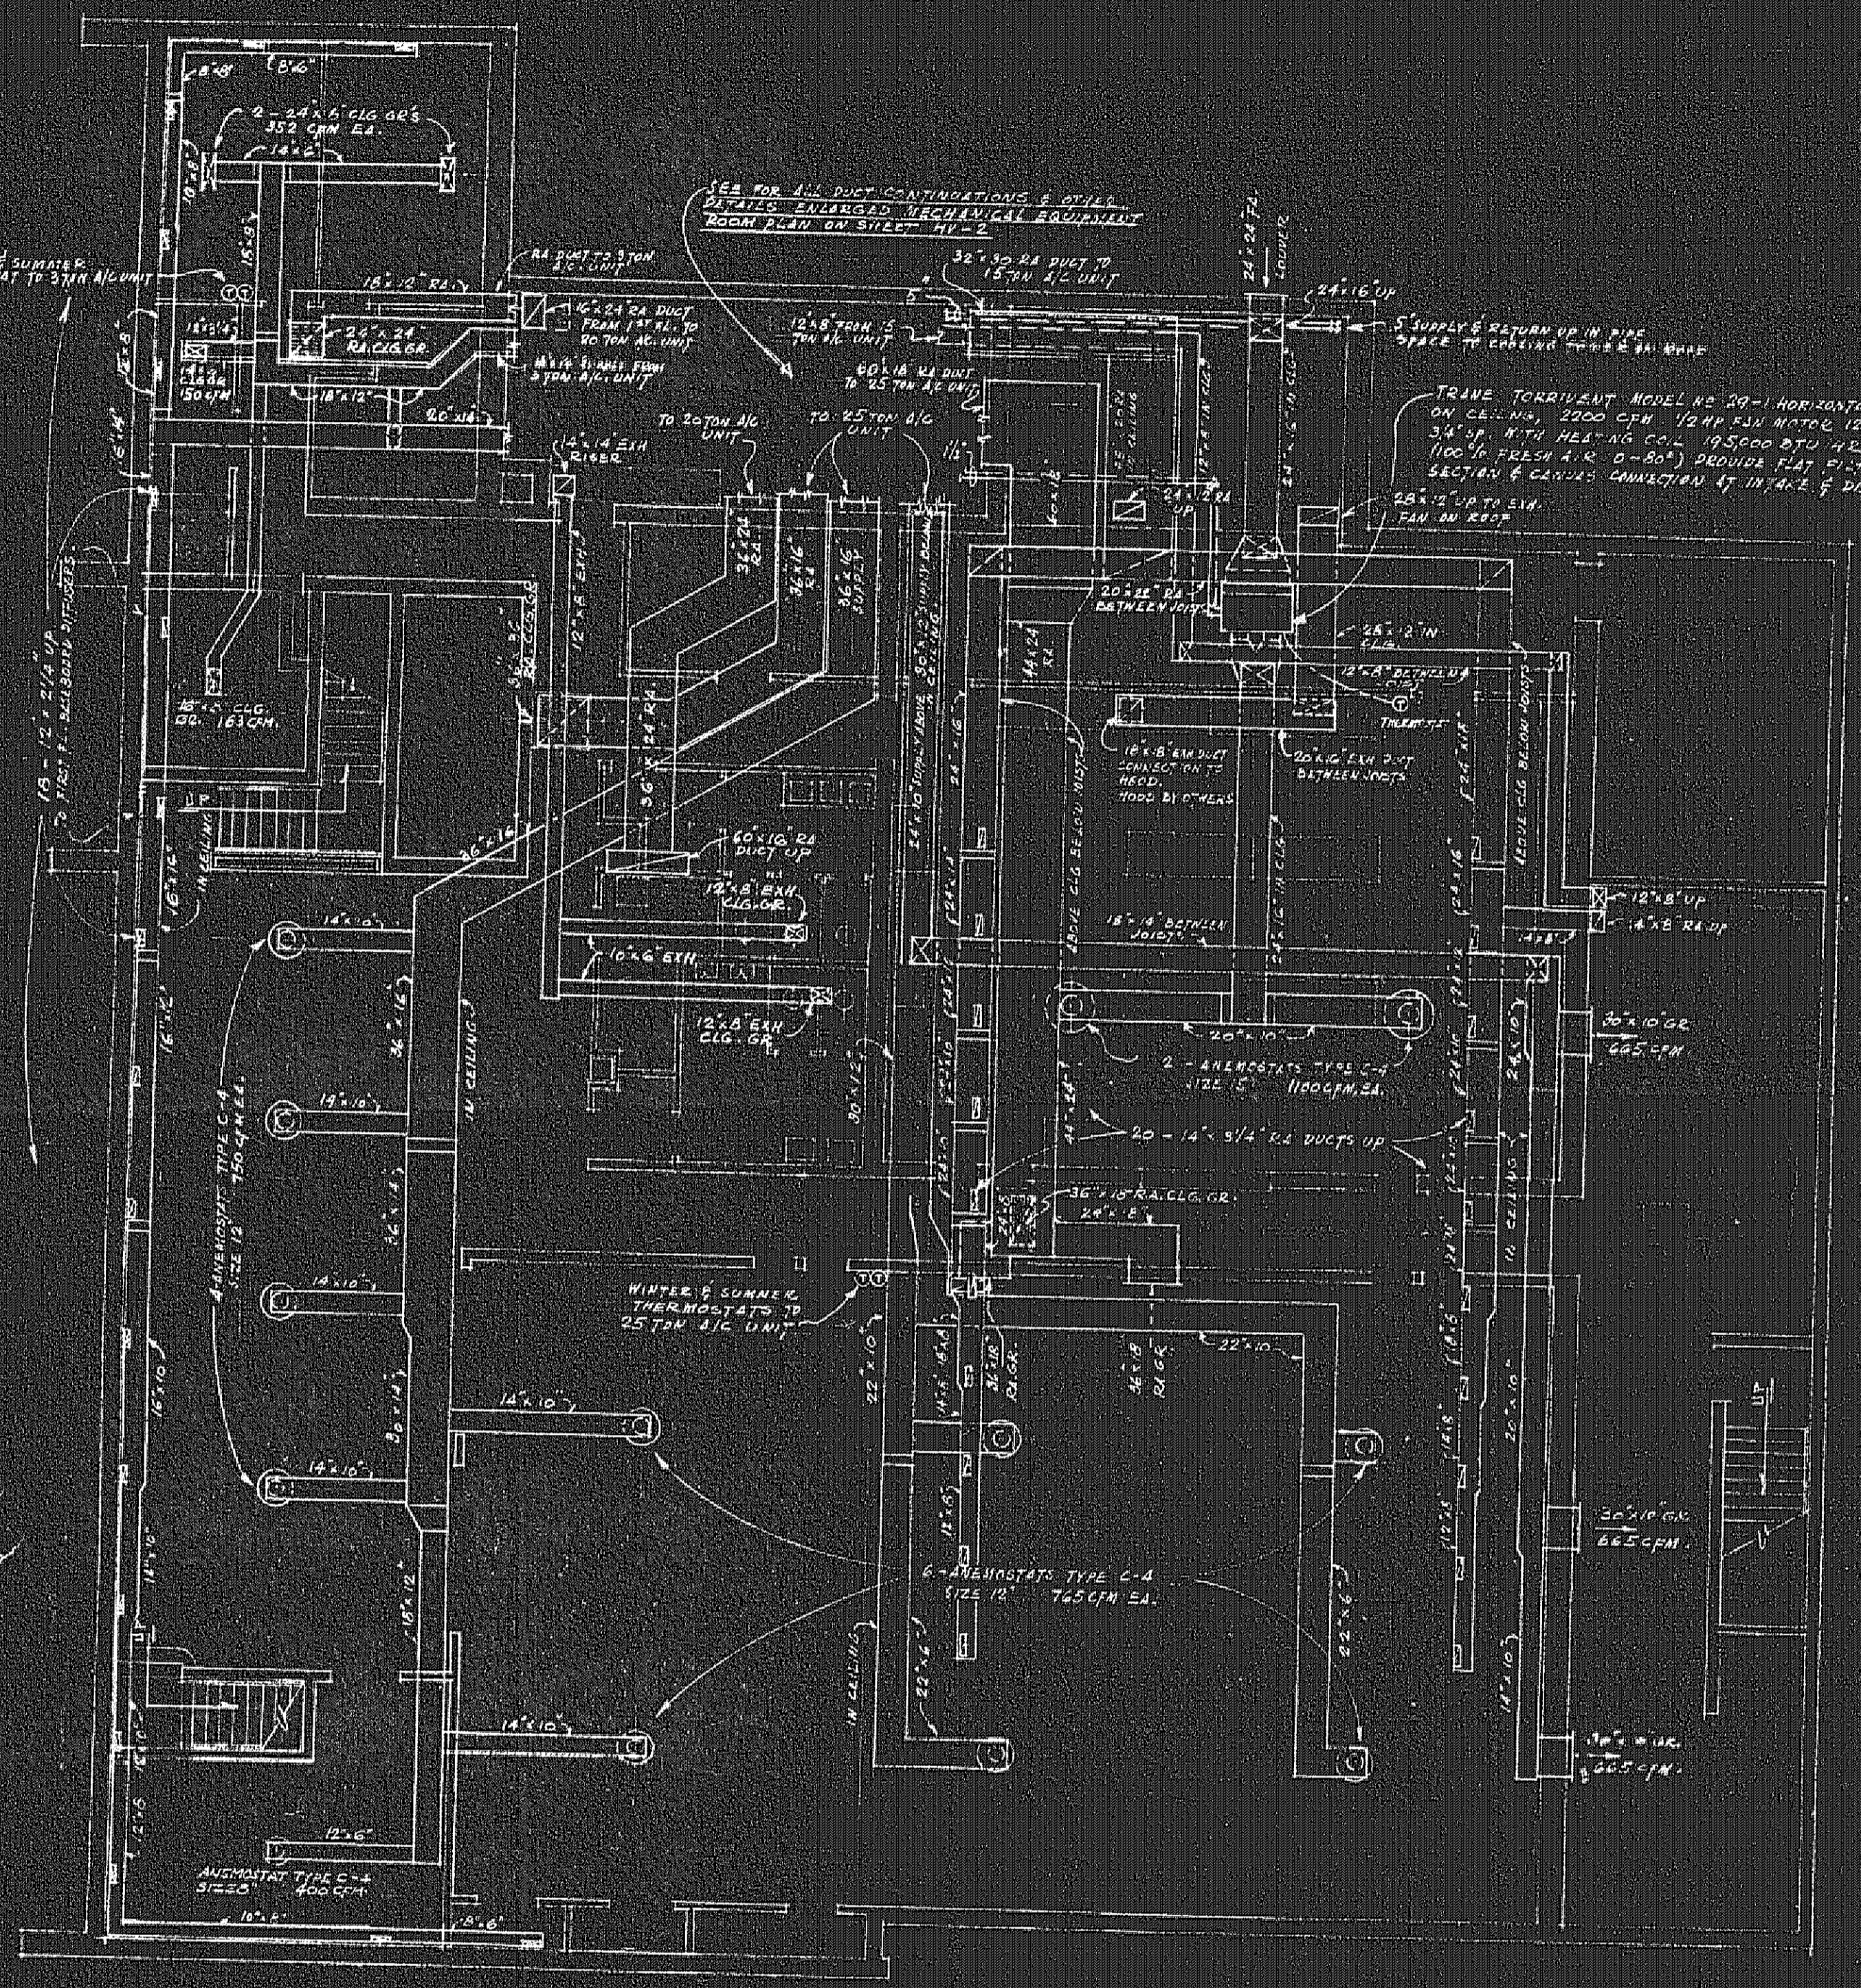


GROUND FLOOR HEATING & AIR CONDITIONING PLAN
SCALE 1/8" = 1' - 0"

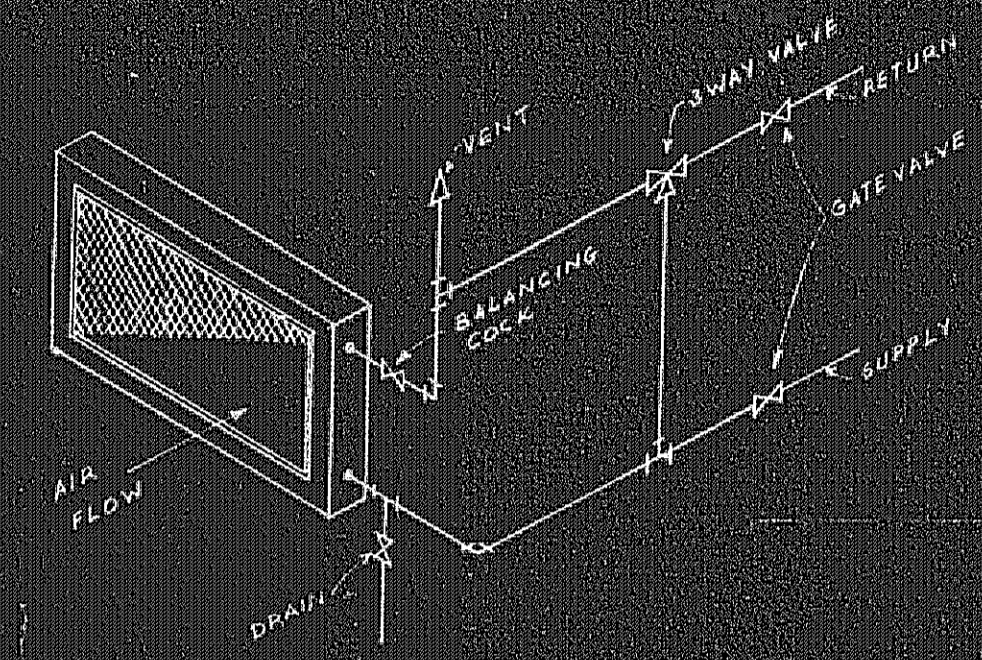

HEATING COIL PIPING DIAGRAM
NO SCALE

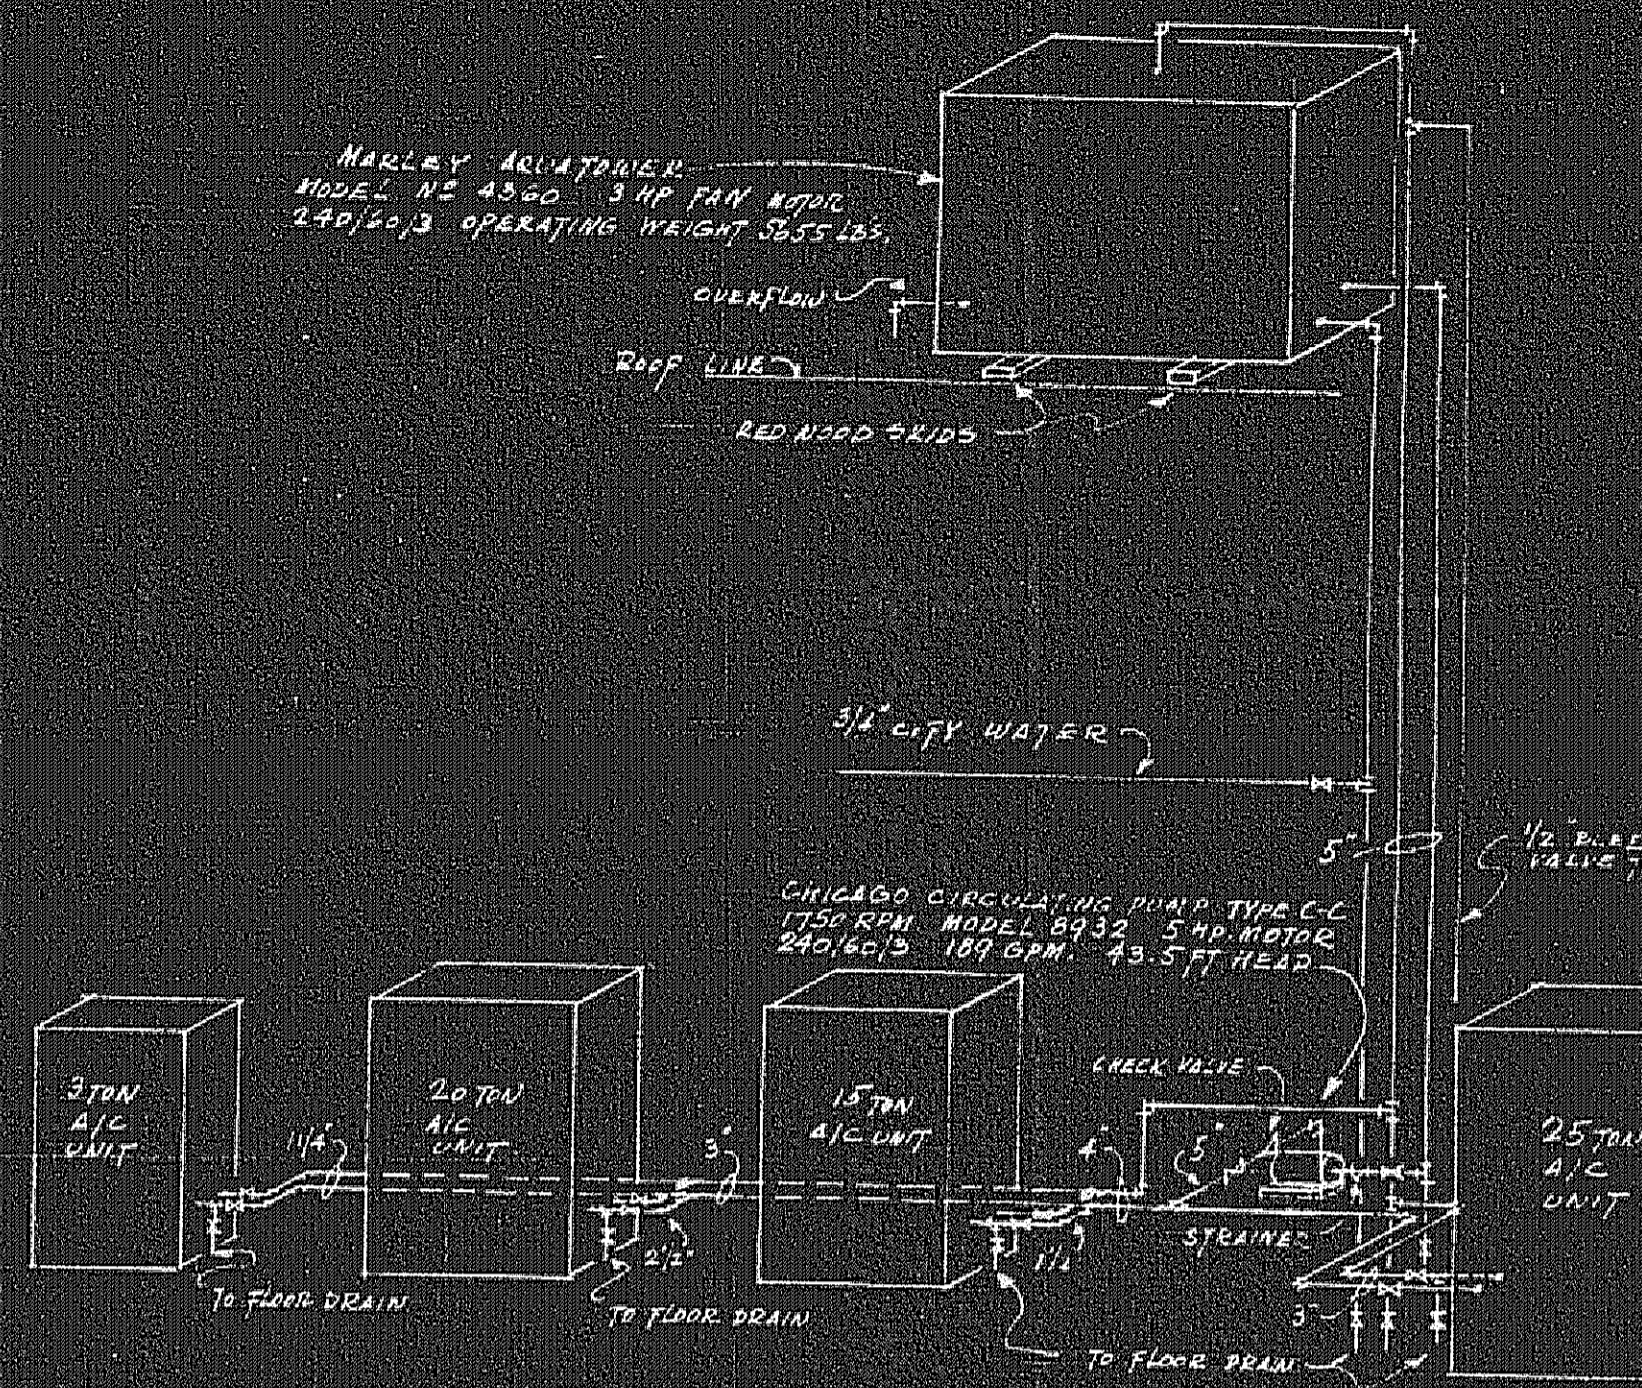

COOLING TOWER PIPING DIAGRAM
NO SCALE

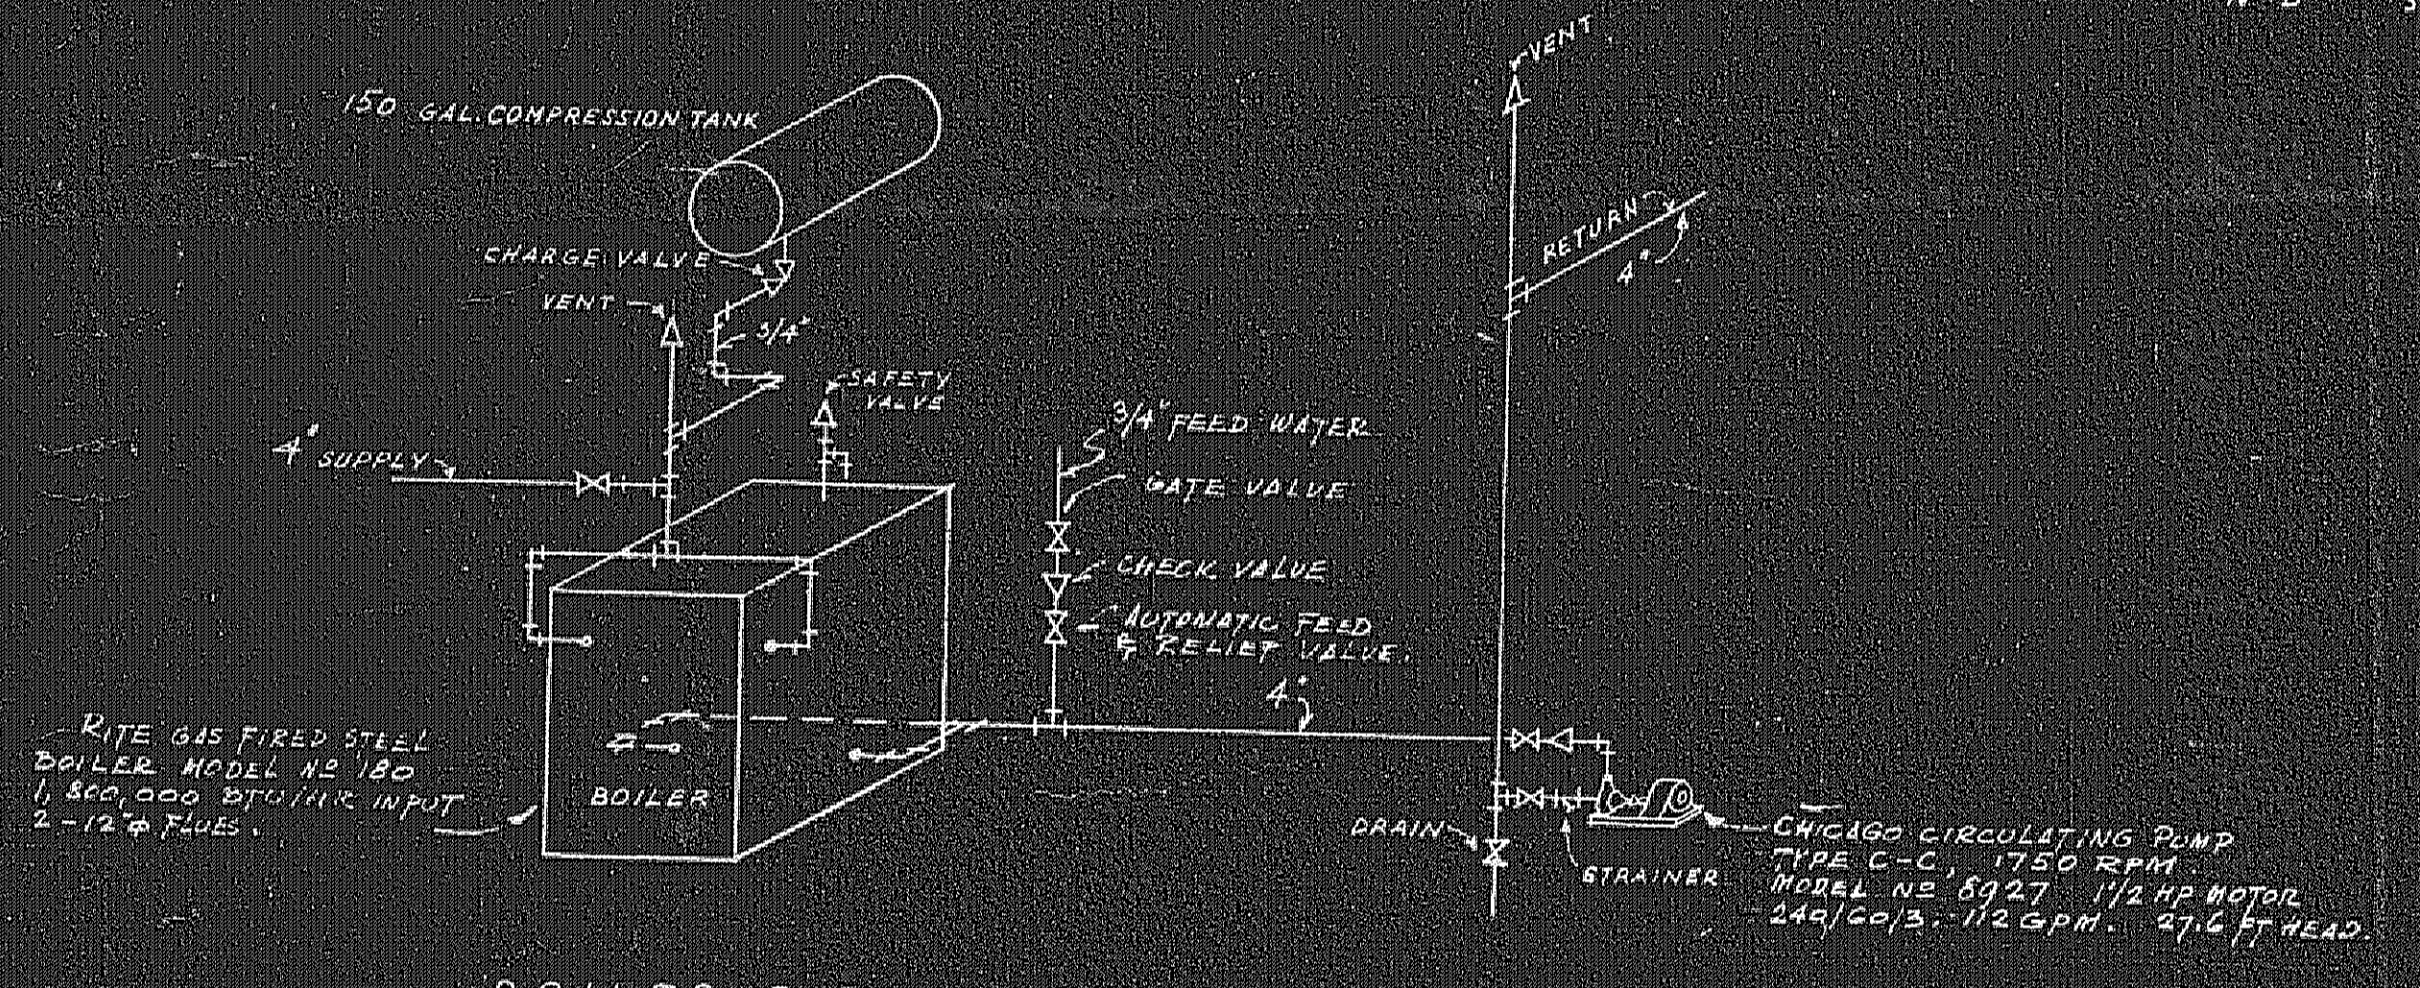

BOILER PIPING DIAGRAM
NO SCALE

PACKAGED SELF CONTAINED & WATER COOLED AIR CONDITIONING UNIT SCHEDULE

A/C UNIT	MAKE	COMPRESSOR MOTOR	EVAPORATOR FAN MOTOR	CFM		HEATING COIL CAPACITY BTU/HR	REMARK
				COOLING	HEATING		
3 TON	YORK OR WHORTHINGTON OR CHRYSLER WITH HEATING COIL INSIDE OF UNIT	3 1/4 HP, 240/00/3	1/2 HP, 240/00/3	1200	1200	15,700	
15 TON		2-7 1/2 HP, 240/00/3	3 1/4 HP, 240/00/3	5400	6000	995,500	
20 TON		20 HP, 240/00/2	3 1/4 HP, 240/00/3	7000	7000	342,000	
25 TON		25 HP, 240/00/3	5 HP, 240/00/3	8000	10,000	176,400	

